





HUDSON & ASSOCIATES
ARCHITECTS
150 WEST QUEENS HW SUITE 201
HAMPTON, VA 23069
(757) 722-1844


BROGDEN LANE
ICE/MR HOME
FOR HNN C5B



2712 SOUTHERN BLVD., SUITE 301
VIRGINIA BEACH, VIRGINIA 23462
PHONE: 757.253.5381
FAX: 757.253.6419
EMAIL: information@pmedg.com



SEPTEMBER 3, 2008



FLOOR PLAN -
MECHANICAL


REVISION DATE
9/30/08

JOB NUMBER 0704


M2.01

NOTES: (THIS SHEET ONLY)

- SEE ATTIC PLAN ON SHEET M2.02 FOR CONTINUATION.
- ROUTE RS/R/L PIPING TO APPROPRIATE CASED COIL IN THE SHORTEST POSSIBLE MANNER WHILE REMAINING CONCEALED.
- COORDINATE DUCT INSTALLATION WITH PLUMBING PIPING.
- SEE "DRYER CONNECTION DETAIL", THIS SHEET.
- PROVIDE SHEET METAL ENCLOSURE MOUNTED TO WALL TO COVER REFRIGERANT LINE SETS.
- RANGE HOOD EXHAUST BY GENERAL CONTRACTOR. SEE ARCHITECTURAL DRAWINGS & SPECIFICATIONS.
- ROUTE DUCT BETWEEN JOISTS.
- ROUTE DUCT IN SOFFIT.

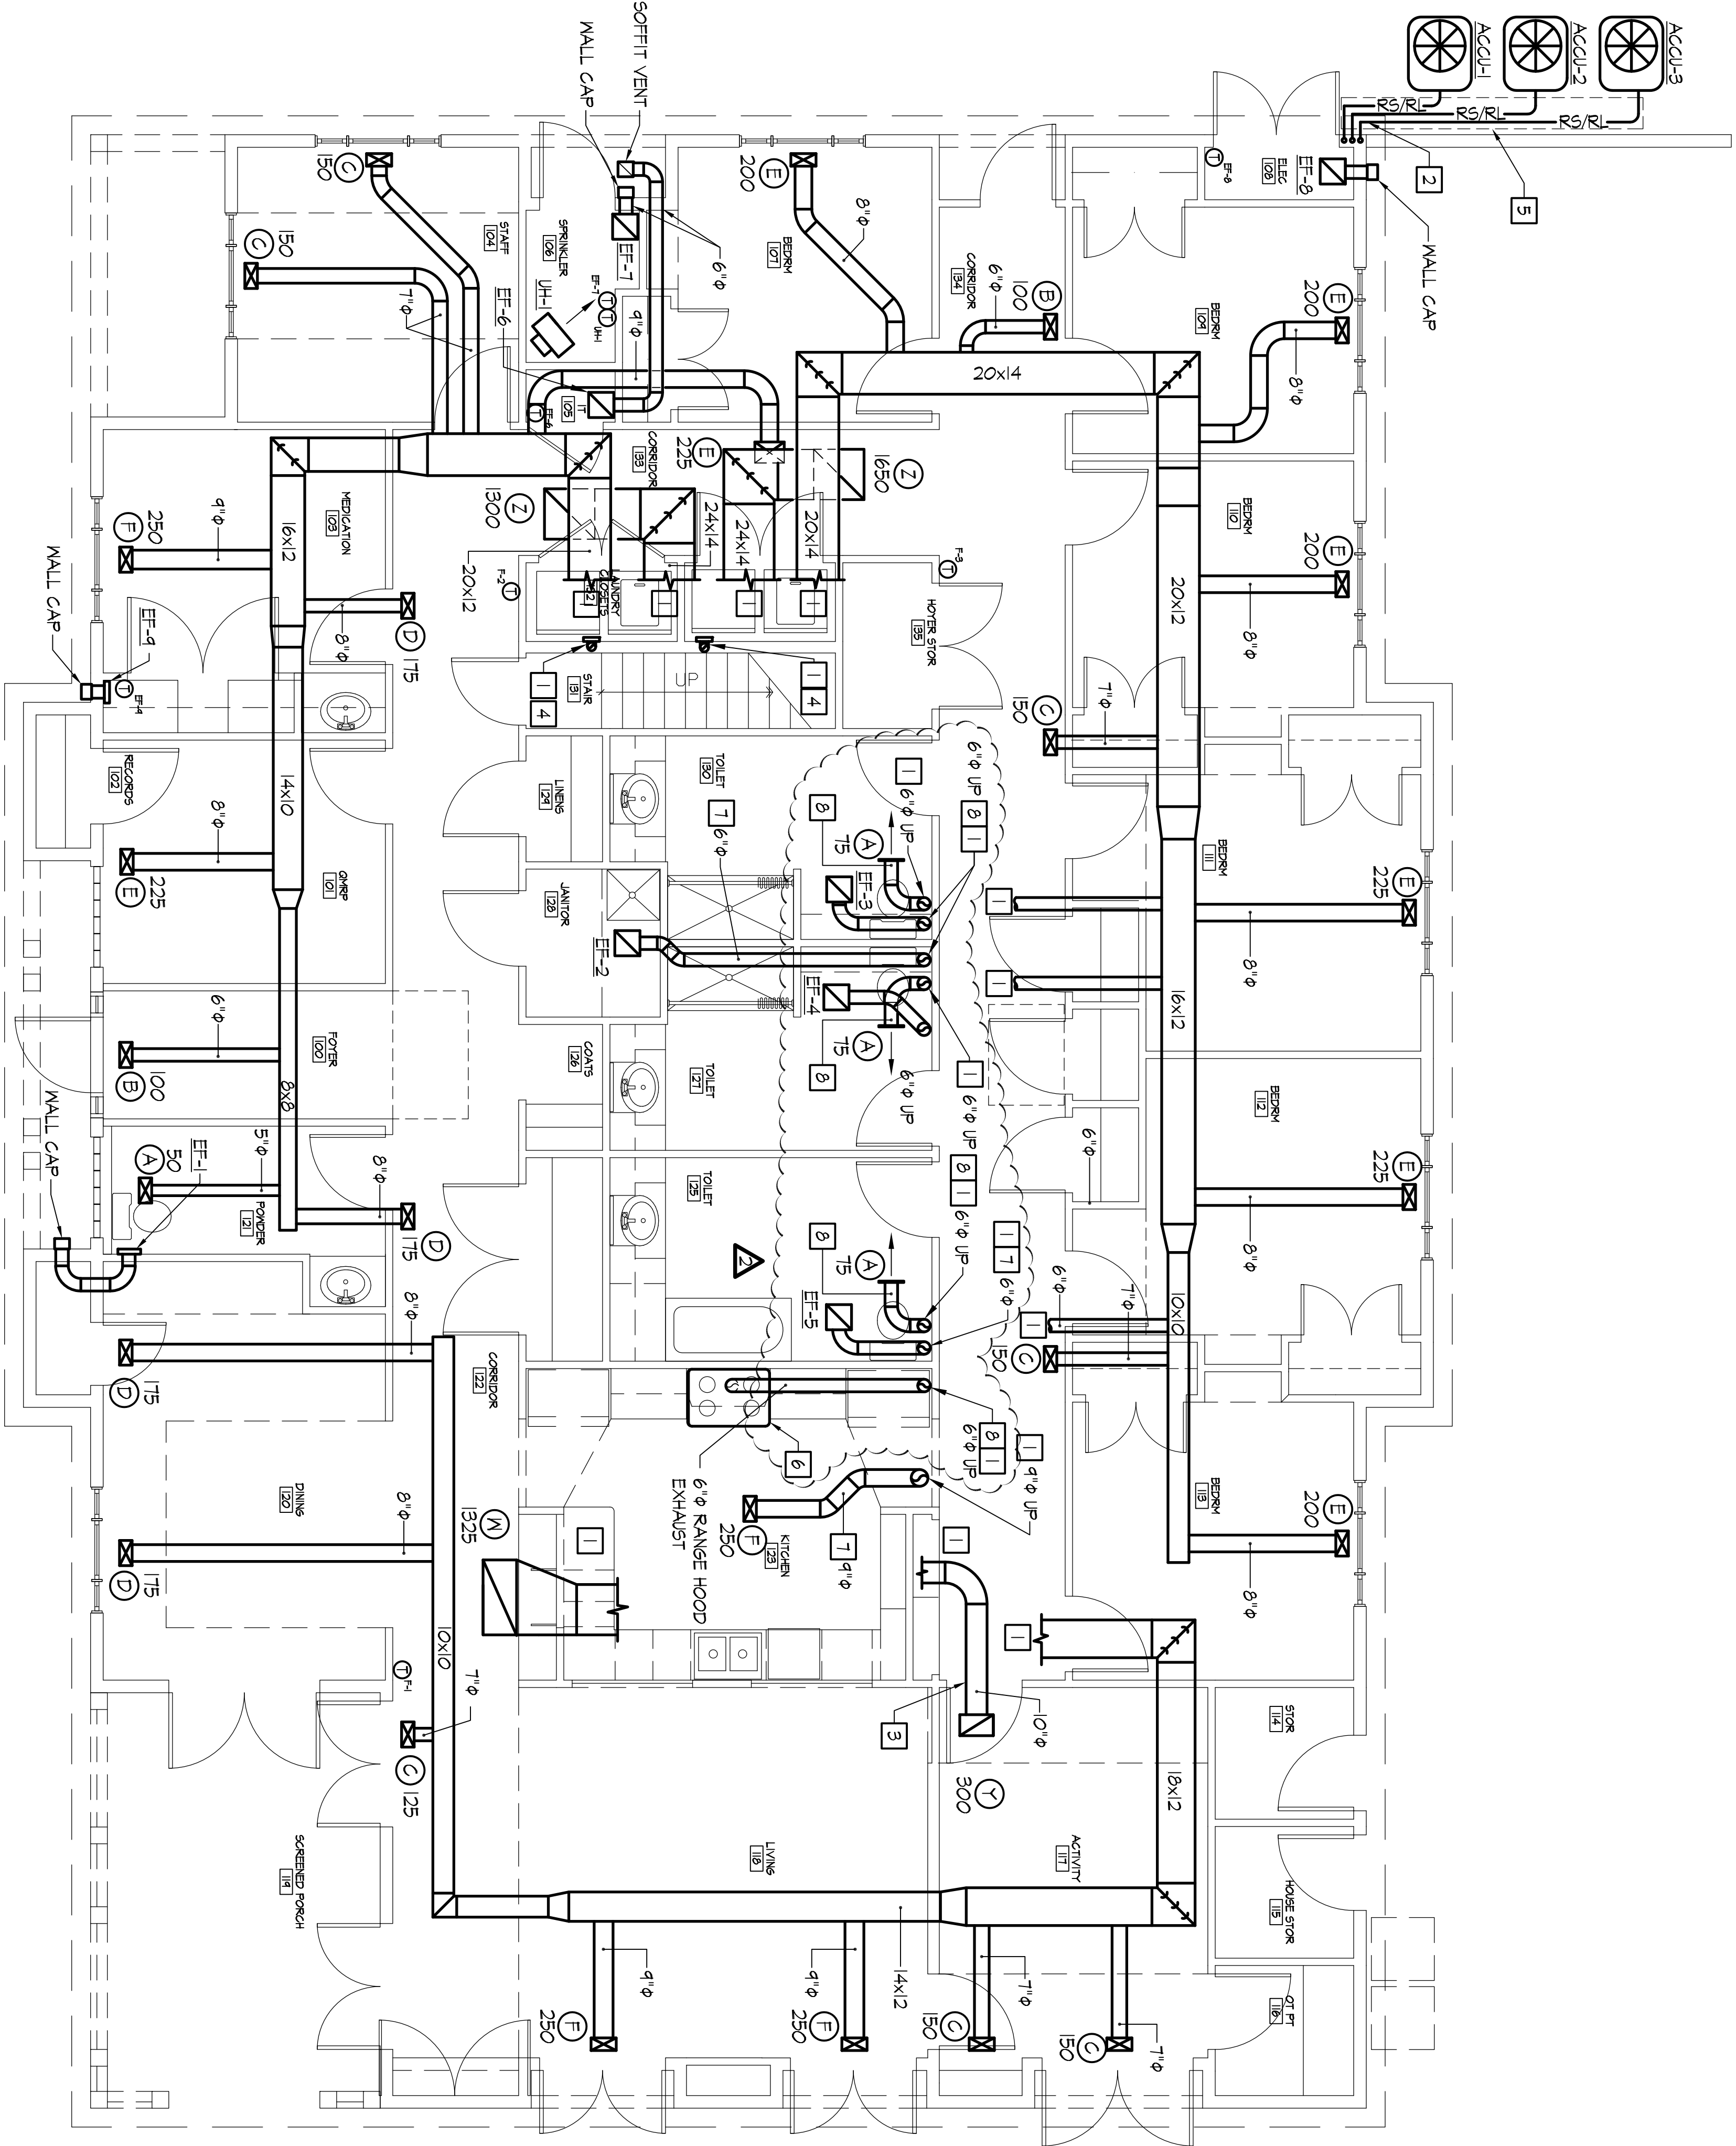

FLOOR PLAN - MECHANICAL
SCALE: 1/4" = 1'-0"



DRYER CONNECTION DETAIL

NO SCALE